



PRODUCT DATA AND INSTALLATION SHEET


MRT16 SERIES MULTI-RANGE TIME DELAY SWITCHES (12 OR 24 V AC/DC VERSION)

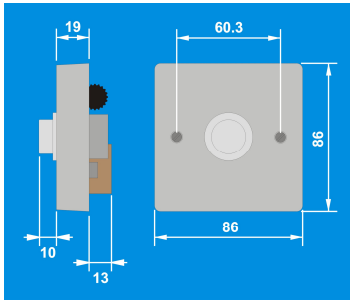


MRT16-PB
Push button activation with optional external trigger

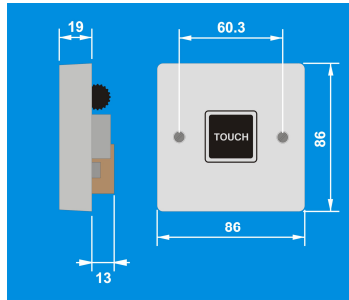

MRT16-TA
Touch activation with optional external trigger

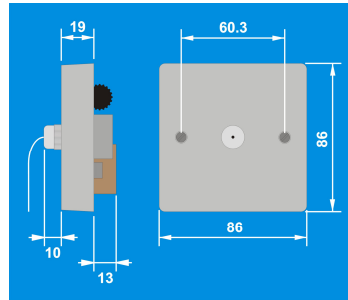

MRT16-PC
Pull cord activation with optional external trigger

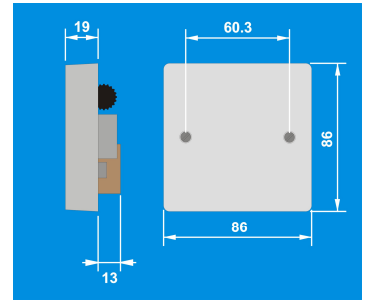

MRT16-REM
Remote activation—external trigger only

DESCRIPTION AND OPERATION

The MRT16 series of time delay switches are designed to provide timed control of lighting, heating or ventilation loads. Using push button, touch (light press required), pull cord or remote activation, the user can switch on a load for a preset time period and have the load turn off automatically after the time period has elapsed.

Multiple timing ranges come as standard to allow the time out period to be set accurately. Time setting is achieved using switches and a thumb-wheel at the rear of the unit.

Several modes of operation are selectable using switches:

- On/off: triggering the timer will turn on the load and start the timing. Triggering the timer again during timing will immediately turn off the load and stop the timing.
- Resetting: triggering the timer will turn on the load and start the timing. Triggering the timer again during timing will re-start the timing period. When using an external trigger in this mode, the timer will not start until the trigger is removed making it ideal for pump or fan overrun applications.
- Non-resetting: triggering the timer will turn on the load and start the timing. Triggering the timer again during timing will have no effect.

WIRING

Wire the MRT16 timers as in diagram 1. Connection to the TRIG terminal is optional on all units except the MRT16-REM.

Applying a live to the trigger terminal will start the timer running. A momentary switch can be used, for example, in corridor lighting applications. A permanent input can be used, for example, in pump overrun applications.

To switch from more than one position simply wire two or more units in parallel to achieve two way and intermediate switching, or use the trigger terminal with a slave switch.

When installing touch switches do not fix to a vibrating or uneven surface.

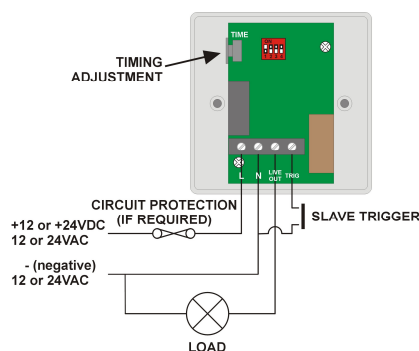


Diagram 1 Standard Wiring


INSTALLATION

Warning. This device works at mains potential. Be sure to take care when working with electricity.

1. Make sure the load is connected and in working order.
2. Isolate the mains supply to the circuit at the main consumer unit.
3. Connect the controller via the terminal block. Live supply to the *L* terminal, Neutral to the *N* terminal and the load to the *LIVE OUT* terminal. Where required connect the external trigger to the *TRIG* terminal.
4. Set the timing range according to the diagram below. Set the thumbwheel to the time setting (anticlockwise is minimum, clockwise is maximum).



5. Set the function according to the diagram below (see above for description).

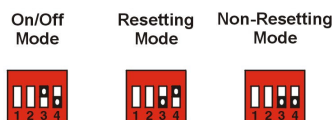

6. Screw the unit to the wall and switch the mains supply back on at the distribution board.

FAULT FINDING

LOAD DOES NOT COME ON

Check to see if the live supply to the circuit is good. Strap across the *L* and *LIVE OUT* terminal to check.

LOAD DOES NOT GO OFF

Check that the time setting is correct.

When using external triggers, ensure that live is removed from the trigger terminal to enable the timer to start (for resetting mode only).

SPECIFICATION

LOAD

16 Amp resistive load
 10 Amp incandescent lighting
 6 Amp fluorescent lighting
 3 Amp compact fluorescent lighting
 3 Amp low energy lighting
 3 Amp low voltage lighting (switch primary of transformer)
 Fluorescent lighting (max 6 fittings recommended)
 For fluorescent lighting total power factor correction capacitance must not exceed 40µF
 3 Amp fans and ventilation equipment
 Switch SON lighting loads via a contactor

SUPPLY VOLTAGE 12V version: 12 Volts AC/DC +/- 10%
 24V version: 24 Volts AC/DC +/- 10%

TIMING PERIOD Adjustable 1 second to 2 hours in ranges

FIXING METHOD Surface fixing 25mm deep plastic surface mount moulded box.
 Flush fixing 25mm steel wall box or 32mm deep cavity wall box.

TERMINAL CAPACITY 4.0mm²

MATERIAL TYPE Flame retardant ABS
 Class 2

TEMPERATURE CONFORMITY -10 °C to 35 °C
 EMC-89/336/EEC
 LVD-73/23/EEC



PART NUMBERS

MRT16-PB 12V	Push button activated multi-range timer 12VAC/DC
MRT16-PB 24V	Push button activated multi-range timer 24VAC/DC
MRT16-TA 12V	Touch activated multi-range timer 12VAC/DC
MRT16-TA 24V	Touch activated multi-range timer 24VAC/DC
MRT16-PC 12V	Pull cord activated multi-range timer 12VAC/DC
MRT16-PC 24V	Pull cord activated multi-range timer 24VAC/DC
MRT16-REM 12V	Remote activated multi-range timer 12VAC/DC
MRT16-REM 24V	Remote activated multi-range timer 24VAC/DC

IMPORTANT NOTICE!

This device should be installed by a qualified electrician in accordance with the latest edition of the IEE wiring regulations.

Total Lighting & Controls
 8 Calspick Way, Longlevens, Gloucester
 Tel: 01452 537421 Mob:07974 419232